




**6 WALL SECTION**  
SCALE 3/8" = 1'-0"




**5 WALL SECTION**  
SCALE 3/8" = 1'-0"

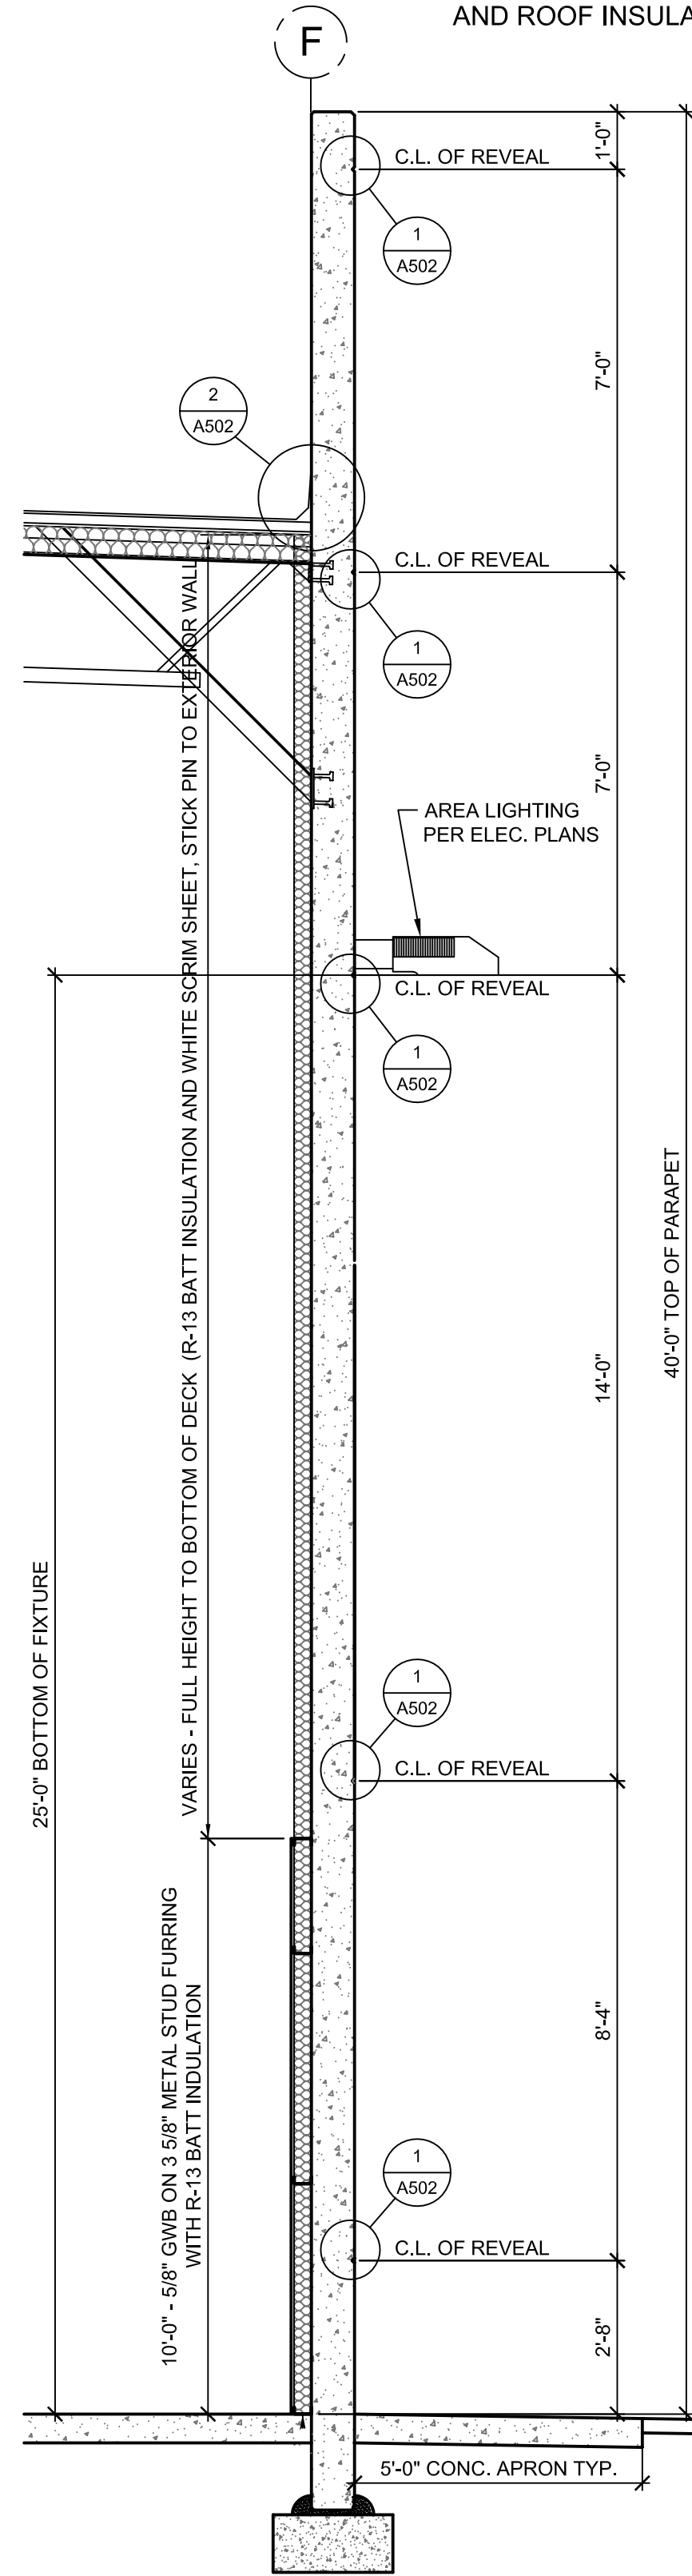


**4 WALL SECTION**  
SCALE 3/8" = 1'-0"

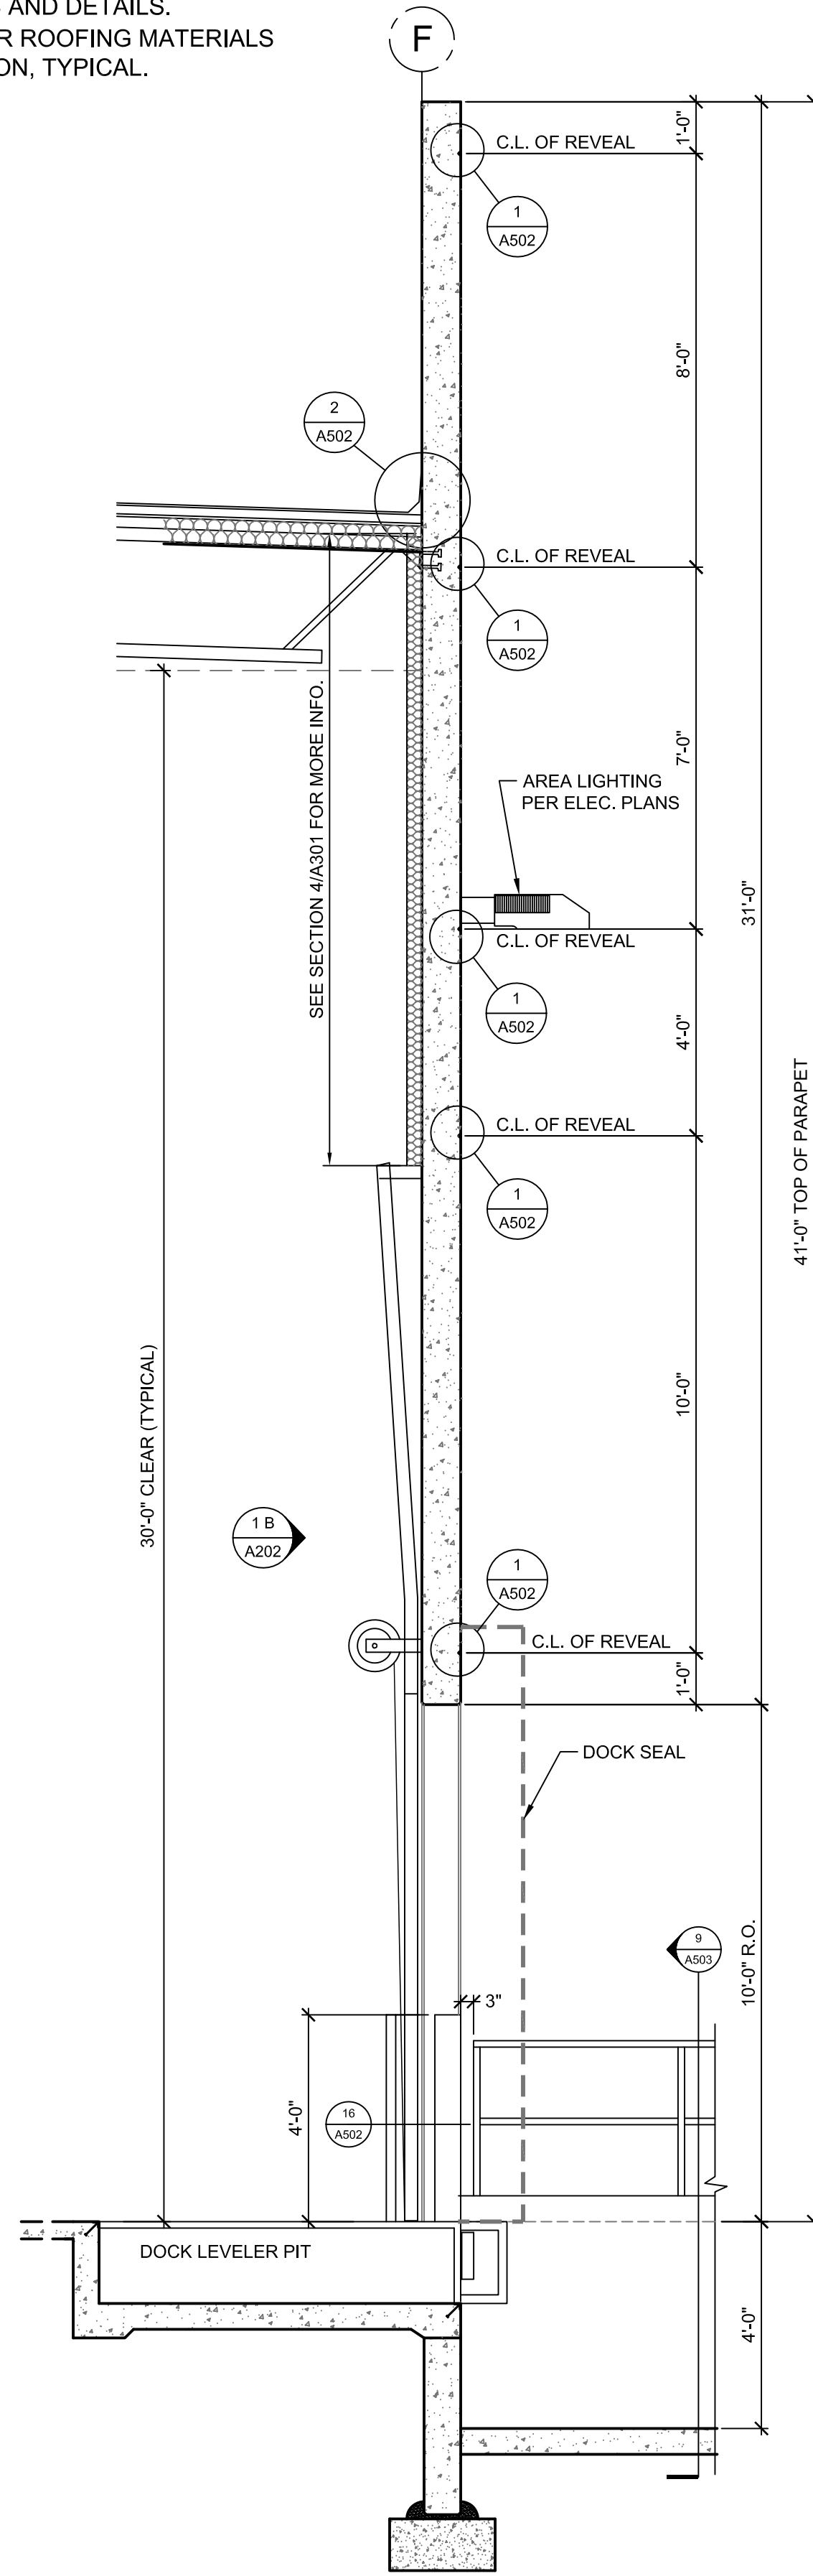

**3 WALL SECTION**  
SCALE 3/8" = 1'-0"

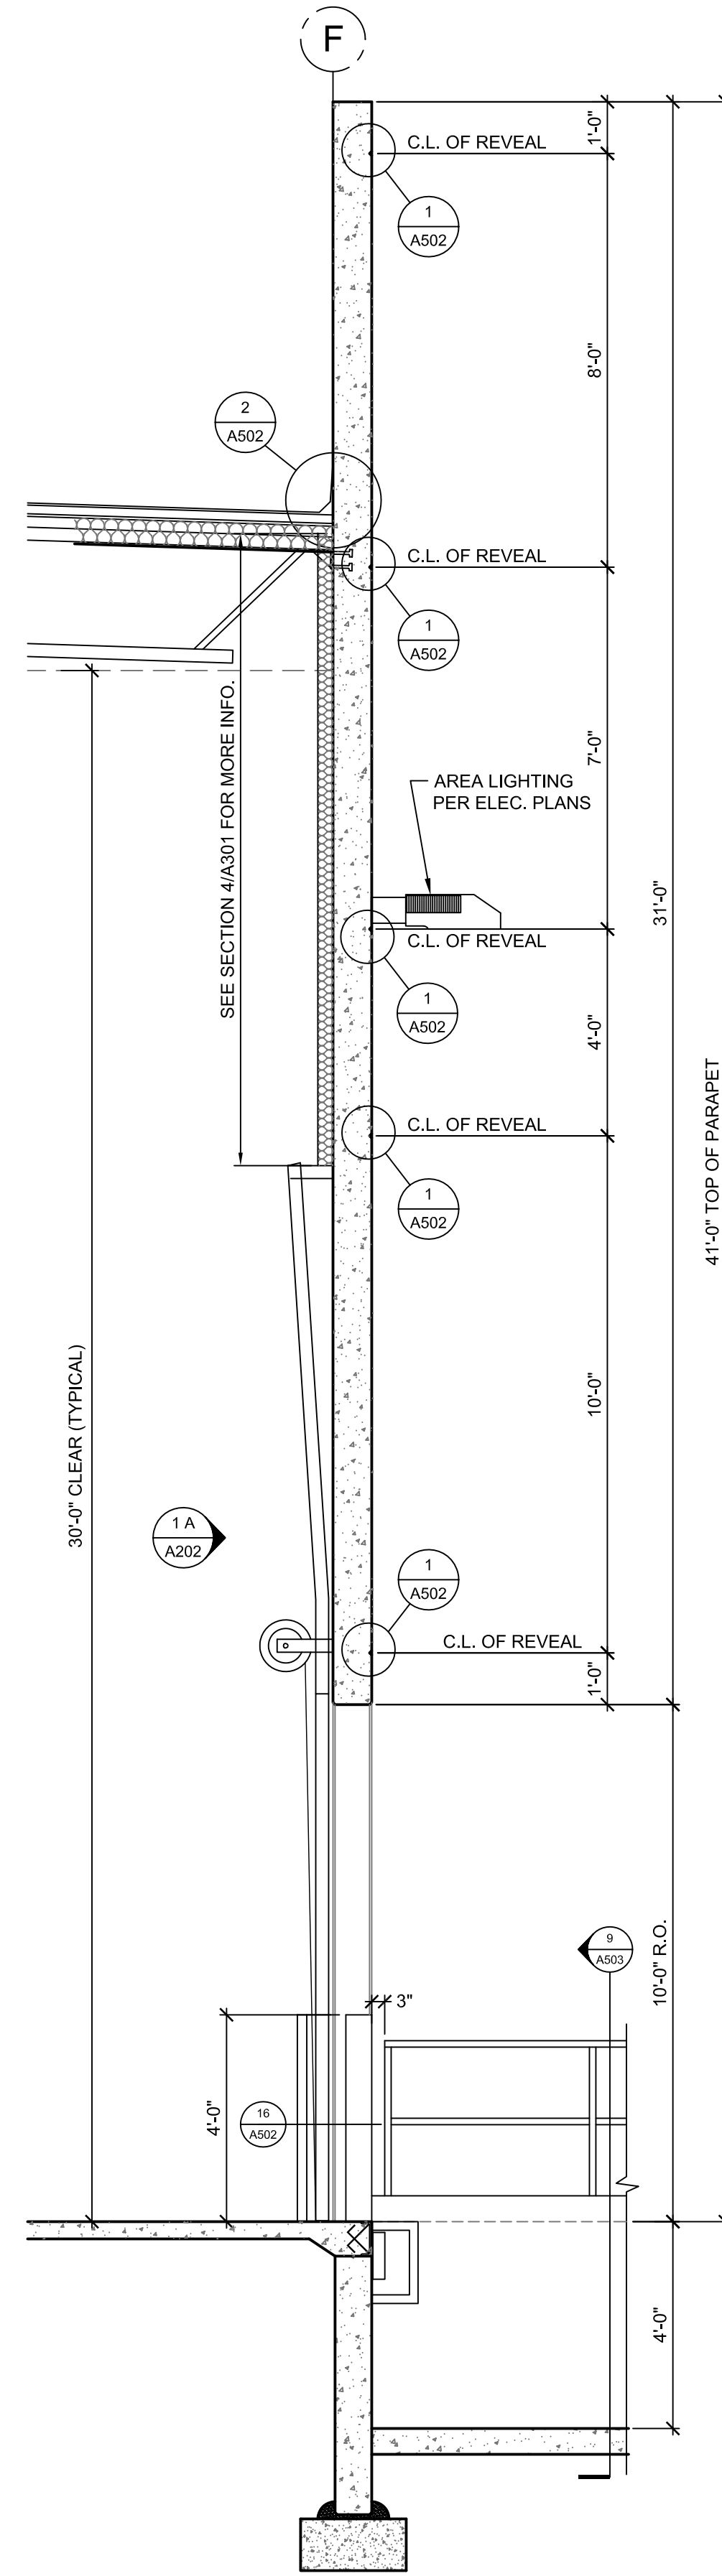


**2 WALL SECTION**  
SCALE 3/8" = 1'-0"



**1 WALL SECTION**  
SCALE 3/8" = 1'-0"

CITY OF  
**Goodyear** Approved 07/01/21 21-2119 - VIP PRODUCTS  
**GENERAL NOTES FOR SECTIONS**

1. ALL INSULATING MATERIALS SHALL HAVE A FLAME SPREAD RATING NOT TO EXCEED 25 AND A SMOKE DENSITY NOT TO EXCEED 450, WHEN TESTED IN ACCORDANCE WITH ASTM E 84.
2. COMPARE ALL WALL AND BUILDING SECTIONS FOR TYPICAL NOTES AND DETAILS.
3. SEE STRUCTURAL DRAWINGS FOR TYPICAL STRUCTURAL NOTES AND DETAILS.
4. SEE SHEET A-103 FOR ROOFING MATERIALS AND ROOF INSULATION, TYPICAL.



**VIP PRODUCTS**  
**GOODYEAR, AZ.**  
**WALL SECTIONS**

**A-301**  
40012.010  
25MAR21

